



FLOOR PLAN - PUMP HOUSE #1  
SCALE 1/4" = 1'-0"

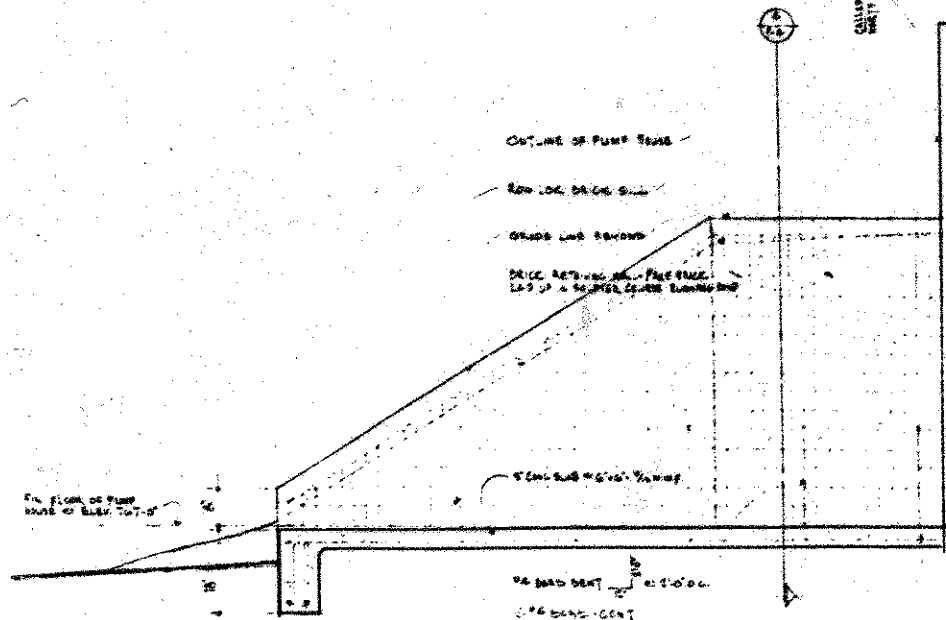


SECTION 3 - ENTRANCE AT SIDE RETAINING WALLS  
SCALE 1/4" = 1'-0"


DOOR ROOF HATCH (SEE DRAWING # 100-1) 1/2" STRONGHOLD BE ATTACHED TO UNDERSIDE OF COVER. METAL STRAP ANCHORED TO WOOD ON INSIDE OF APPROX. 17" DIA. WOOD FRAMING FRAME, HOLD FRAME AFFIXED TO ABOVE SURROUNDING CONCRETE.  
A WIDE SEALANT JOINT ALL AROUND FRAME  
LIQUID SEALING OVER STRUCTURAL ROOF SLAB

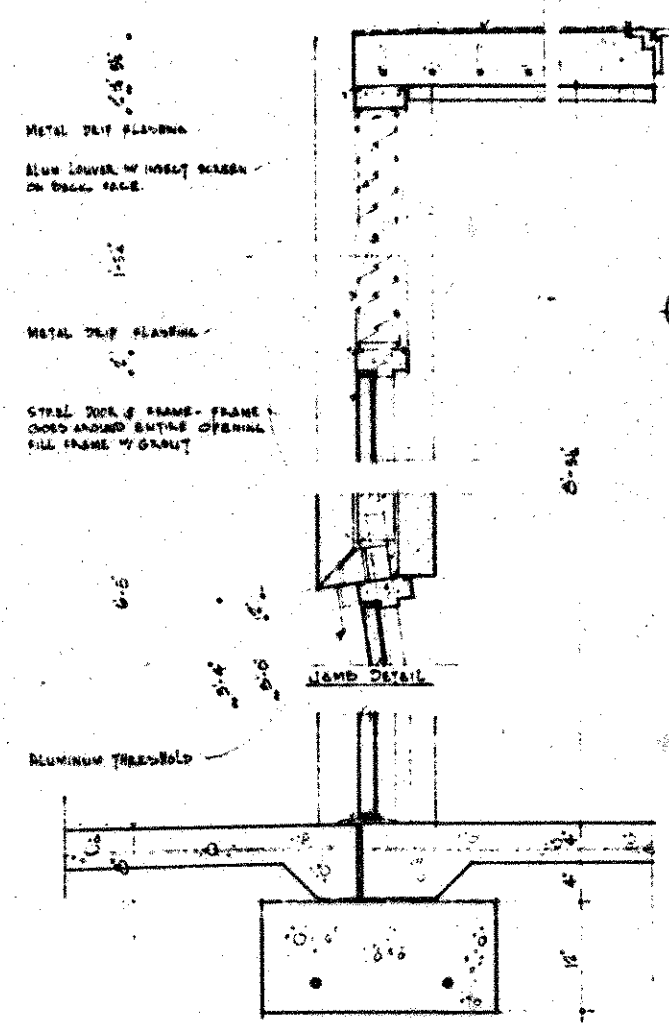

SECTION 4 - THROUGH DOOR & LOUVER ABOVE  
SCALE 1/4" = 1'-0"

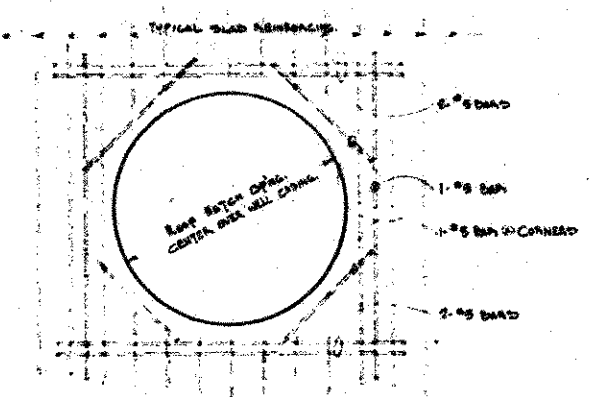


TYPICAL SLAB REINFC. OF ROOF HATCH  
SCALE 1/4" = 1'-0"

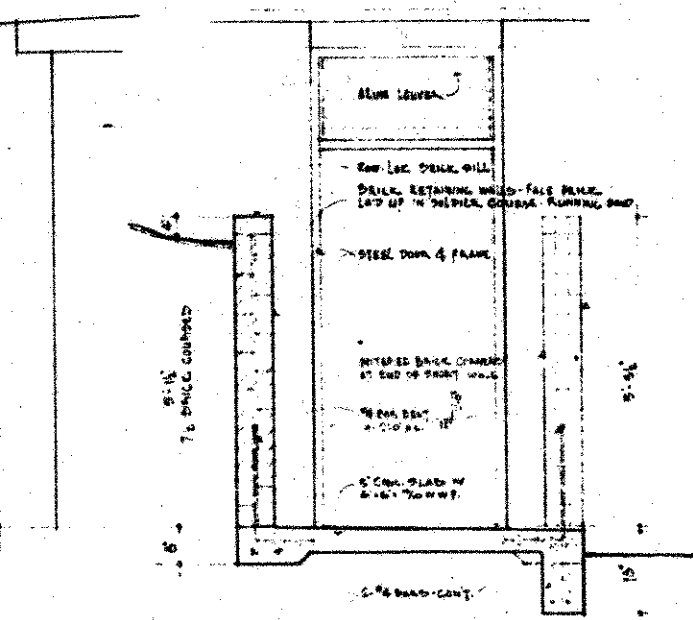


SECTION 5 - THROUGH RETAINING WALLS & ENTRANCE SLAB  
SCALE 1/4" = 1'-0"

SECTION 6 - THROUGH ROOF & ROOF HATCH  
SCALE 1/4" = 1'-0"

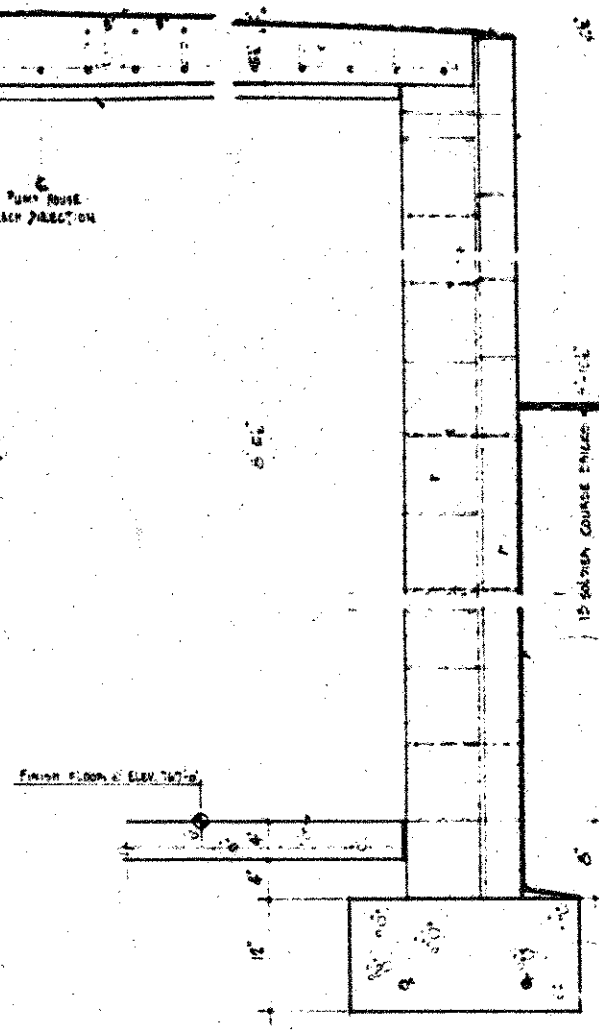

TYPICAL WALL SECTION  
SCALE 1/4" = 1'-0"

SPECIFICATIONS  
1. ALL SPECIFICATIONS AS PER CONCRETE WALL DOCUMENTS APPLY HERE ALSO.  
2. LIQUID SEALING (TERRACON BLASTOCRETE LIQUID APPLIC. SYSTEM) SHALL BE USED ON ROOF TO BE WHITE. ROOFING SHALL CONFORM TO MANUFACTURER'S SPECIFICATIONS. SEALING SHALL BE BY GENERAL CONTRACTOR. (SEE GENERAL NOTES) SYSTEM OR (SEE DRAWING) - EXTERMINATE NEOPRENE-EPHALON ROOF SYSTEM AND BAW ACCEPTANCE.

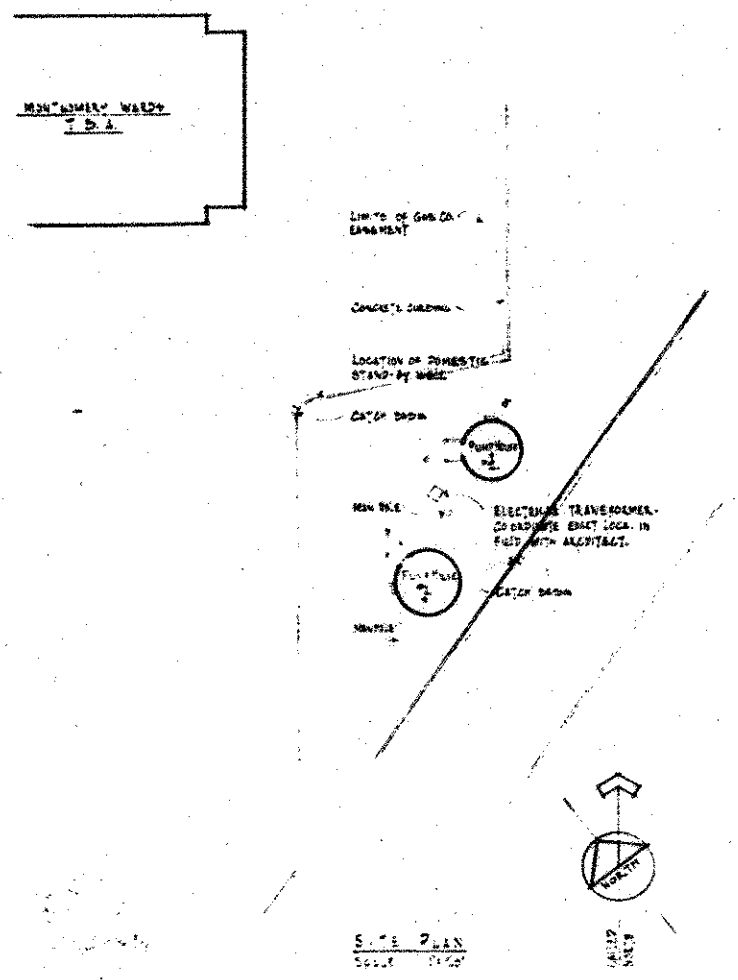

DOOR HATCH - SEE SPECIFICATION BEING STRUCTURAL CONCRETE SLAB. REINFORCING STEEL TO BE #5 BARS @ 12" ON CENTER. (SEE DRAWING # 100-1) TEMP. STEEL TO BE #3 BARS @ 12" ON CENTER.

FALL DRAIN - SOLID BRASS. GRADE FINISH DRAIN.  
6" DIA. SPONGE BRASS DRAIN TO CONCRETE WITH WATER-PROOF ADHESIVE.  
WARRANTY SHALL BEAT 1 YEAR.  
GRADE LINE APPROX. 51.75' TO 51.80'.  
6" BLOCK - FILL ALL CONCRETE SOLID W/ GRAVEL.  
CONCRETE SHALL BE JUST BELOW GRADE. LAY UP IN SOLID BRASS COURSE.  
DAMP PROOFING.  
6" DIA. SOLID BRASS DRAIN.

STEENWYK, THORNTON ARCHITECTS  
INDIANAPOLIS, INDIANA  
ISSUE DATE: 10/1/57  
FILE NO: 7009-1  
DRAWING NO: 100-1