


FOOTING PAD SCHEDULE			
NO.	SIZE	REQD. REINFORCING	
F-24	3'-0" x 3'-0"	6-#6 BARS @ 12" O.C. E.W.	
F-26	4'-0" x 4'-0"	7-#6 BARS @ 12" O.C. E.W.	
F-28	5'-0" x 5'-0"	7-#6 BARS @ 12" O.C. E.W.	
F-30	6'-0" x 6'-0"	6-#6 BARS @ 12" O.C. E.W.	

NOTES

1. TOP OF FOOTING ELEV. 4'-0" UNLESS NOTED OTHERWISE. (INSIDE OF SLAB.)
2. REINFORCING TO BE SHOWN OVER TO SLAB BEARING THEREAFTER, UNLESS SHOWN BY DRAWINGS.
3. CONCRETE SLAB ON GROUND SHALL BE REINFORCED W/ 6-#6 BARS @ 12" O.C. UNLESS NOTED OTHERWISE.
4. ALL FILL MATERIAL UNDER SLAB SHALL BE THOROUGHLY COMPACTED, AS REQUIRED BY SPECIFICATION, BEFORE PLACING CONC.
5. LAP CONTINUOUS WALL REIN. @ 6 BAR DIAMETERS UNLESS OTHERWISE NOTED. PROVIDE CHAIRS BARS FOR VERTICAL WALL REINFORCING. COVER OF CONC. SHALL BE 3" UNLESS OTHERWISE NOTED.
6. PROVIDE SOLID MASONRY OR FULL CORE OF BLOCK OPEN TO FOUNDATION WALL UNDER ALL BEAM DRIVING POINTS.
7. NO CHASES, RISERS, CONDUITS, OR TROTTING OF MASONRY SHALL OCCUR IN WALLS WITHIN 12" OF 1/2" OF BEAM BEARING.
8. ALL MASONRY WALLS TO EXTEND UP TIGHT TO FLOOR OR ROOF DECK UNLESS SHOWN OTHERWISE.
9. ELECTRICAL CONDUIT OR OTHER PIPES TO BE BARRICADED IN STRUCTURAL CONCRETE FLOOR TO BE PLACED IN ACCORDANCE W/ PCI 508-05 PARAGRAPHS 703.
10. ALLOWABLE SOIL PRESSURE = 3000 P.S.F.

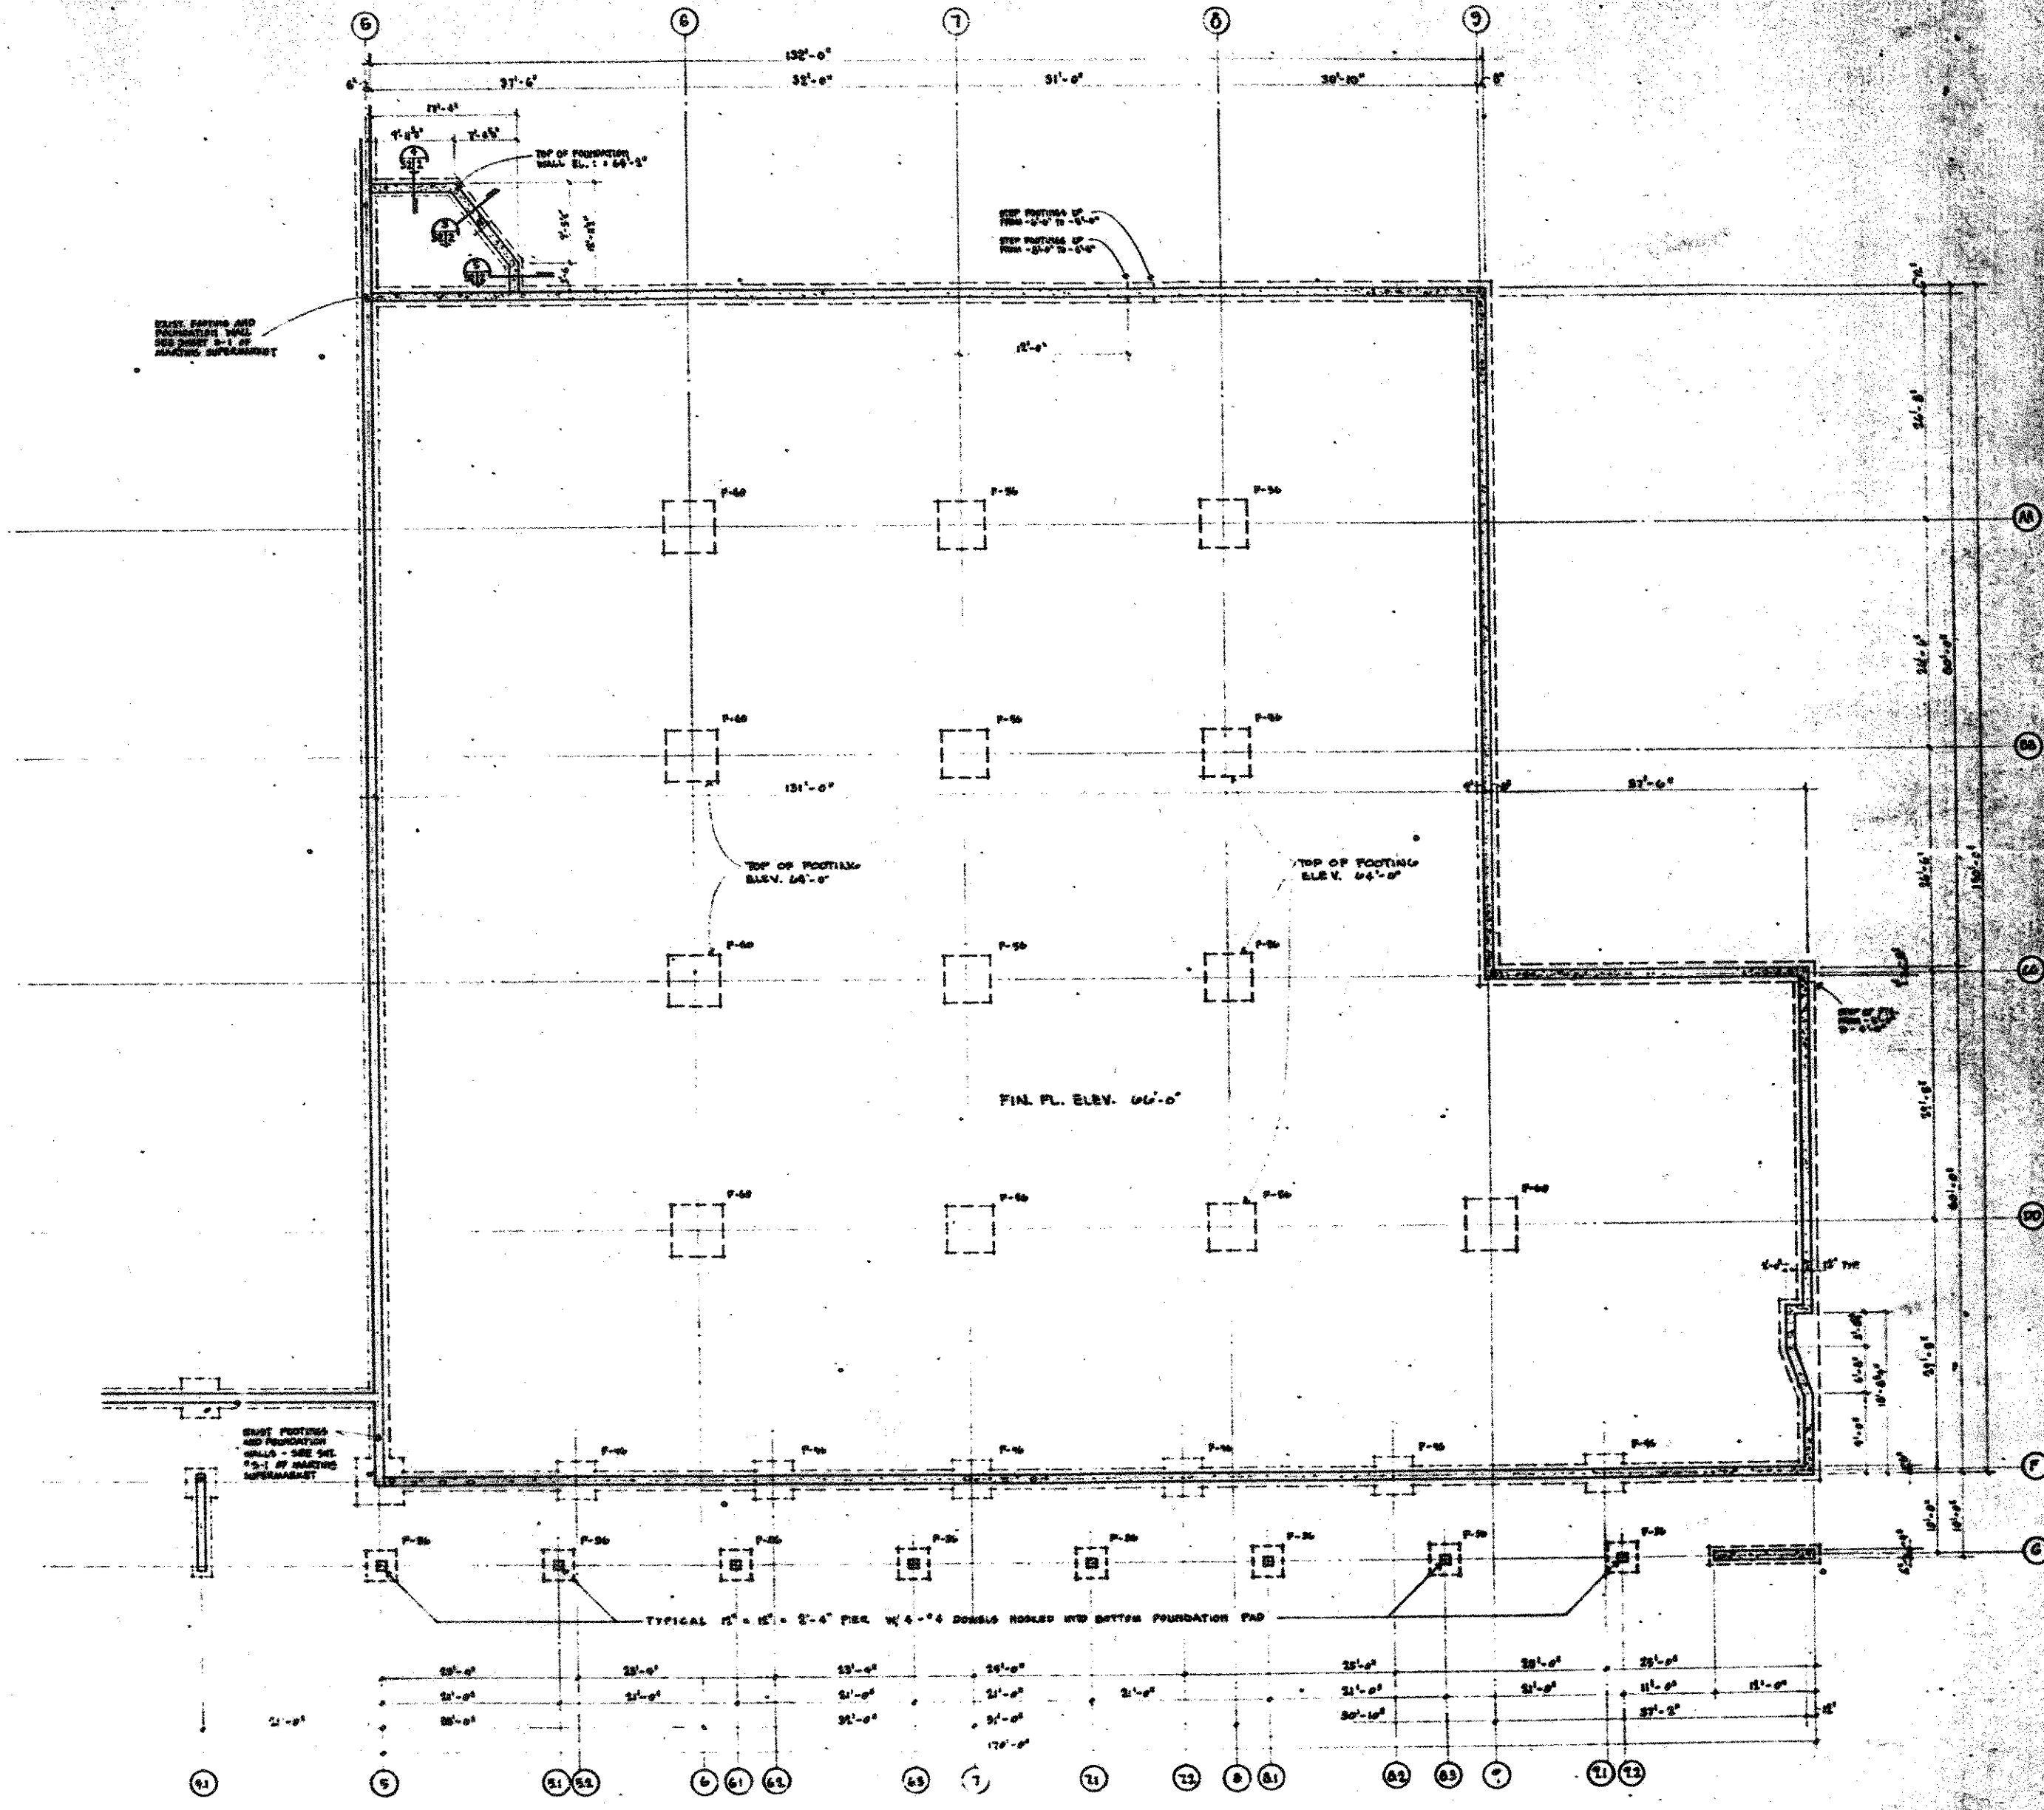

FOUNDATION PLAN
SCALE: 1/8" = 1'-0"

STEENWYK THALL ARCHITECTS
 1000 N. GRAND ROAD, MICHIGAN 48103
 FOUNDATION PLAN