

DATE	1/17/2015
PROJECT NO.	8-12-05
DRAWN BY	AEP

PLUMBING FLOOR PLAN


P1.1

- CONTRACTOR TO VERIFY EXISTING CONDITIONS PRIOR TO COMMENCEMENT OF WORK.
- CONTRACTOR SHALL CONFORM TO SPECIFICATIONS PROVIDED BY THE ARCHITECT.
- CONTRACTOR SHALL VERIFY LOCATION AND CONDITION OF NEAREST ACTIVE SANITARY LINE PRIOR TO COMMENCEMENT OF WORK.
- INDIVIDUALLY VENT ALL PLUMBING FIXTURES AND TIE INTO 4" VRT UNLESS OTHERWISE NOTED IN THE DRAWING. CAP ALL UNUSED VENT PENETRATIONS THRU ROOF.
- REFER TO ARCHITECTURAL DRAWINGS FOR EXISTING FIXTURES TO BE REMOVED.
- CONTRACTOR SHALL REMOVE EXISTING DOMESTIC WATER LINES AND CAP SANITARY LINES AT EXISTING FIXTURES.
- CONTRACTOR SHALL BE RESPONSIBLE FOR REPLACEMENT OF EQUIPMENT DAMAGED IN THE COMPLETION OF THIS PROJECT.
- ALL PLUMBING DROPS SHALL BE ROUTED HIDDEN WITHIN THE WALLS. CONTRACTOR SHALL PROVIDE STOPS IN THE CEILING SPACE.
- REFER TO P2.1 RISER DIAGRAM AND PLUMBING FIXTURE SCHEDULE FOR COMPLETE PIPE SIZES.
- NEW SPRINKLER HEADS MUST BE QUICK RESPONSE TYPE, SEMI-RECESSED CHROME-PLATED HEADS WITH WHITE ESCUTCHEONS.


3 PLUMBING GENERAL NOTES
 NOT TO SCALE

- CONNECT NEW SANITARY SEWER TO EXISTING SANITARY SEWER. FIELD VERIFY EXACT LOCATION.
- CONNECT NEW DOMESTIC COLD WATER TO EXISTING WATER LINE. FIELD VERIFY EXACT LOCATION. PROVIDE WATER METER AT POINT OF CONNECTION.

2 PLUMBING KEYED NOTES
 NOT TO SCALE

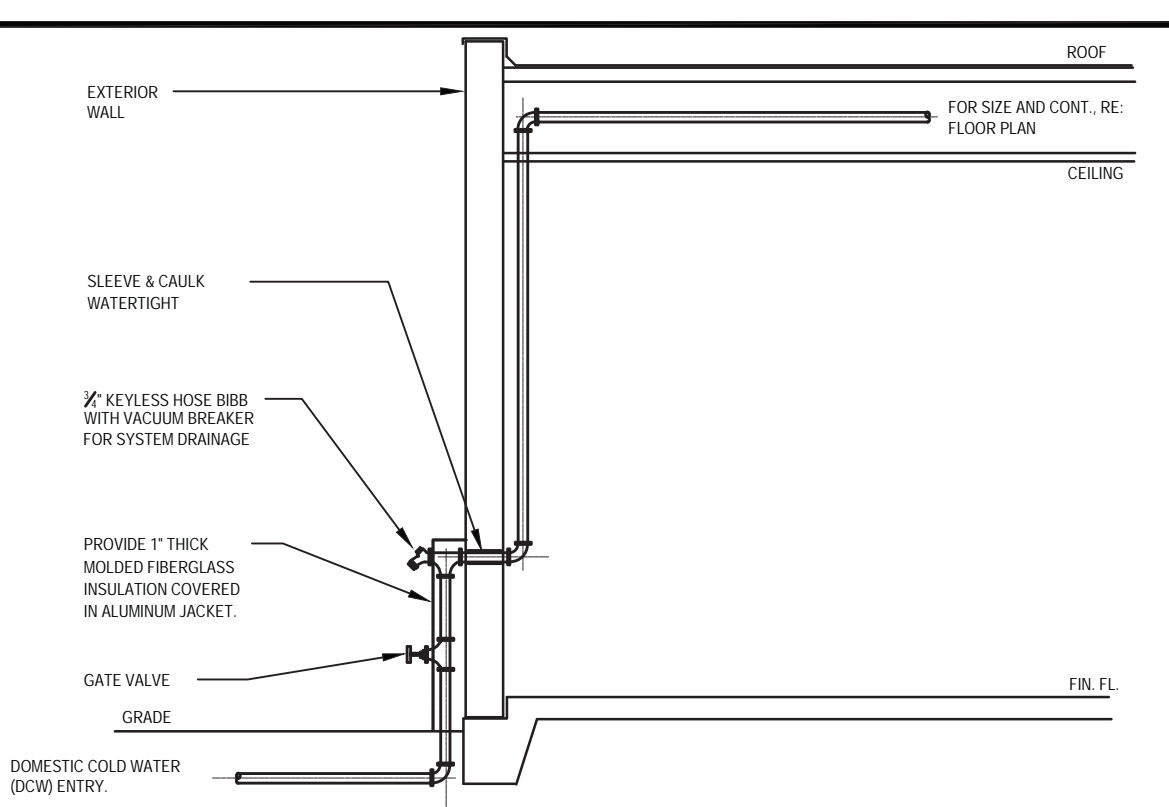

4 WATER SERVICE ENTRY DETAIL
 NOT TO SCALE

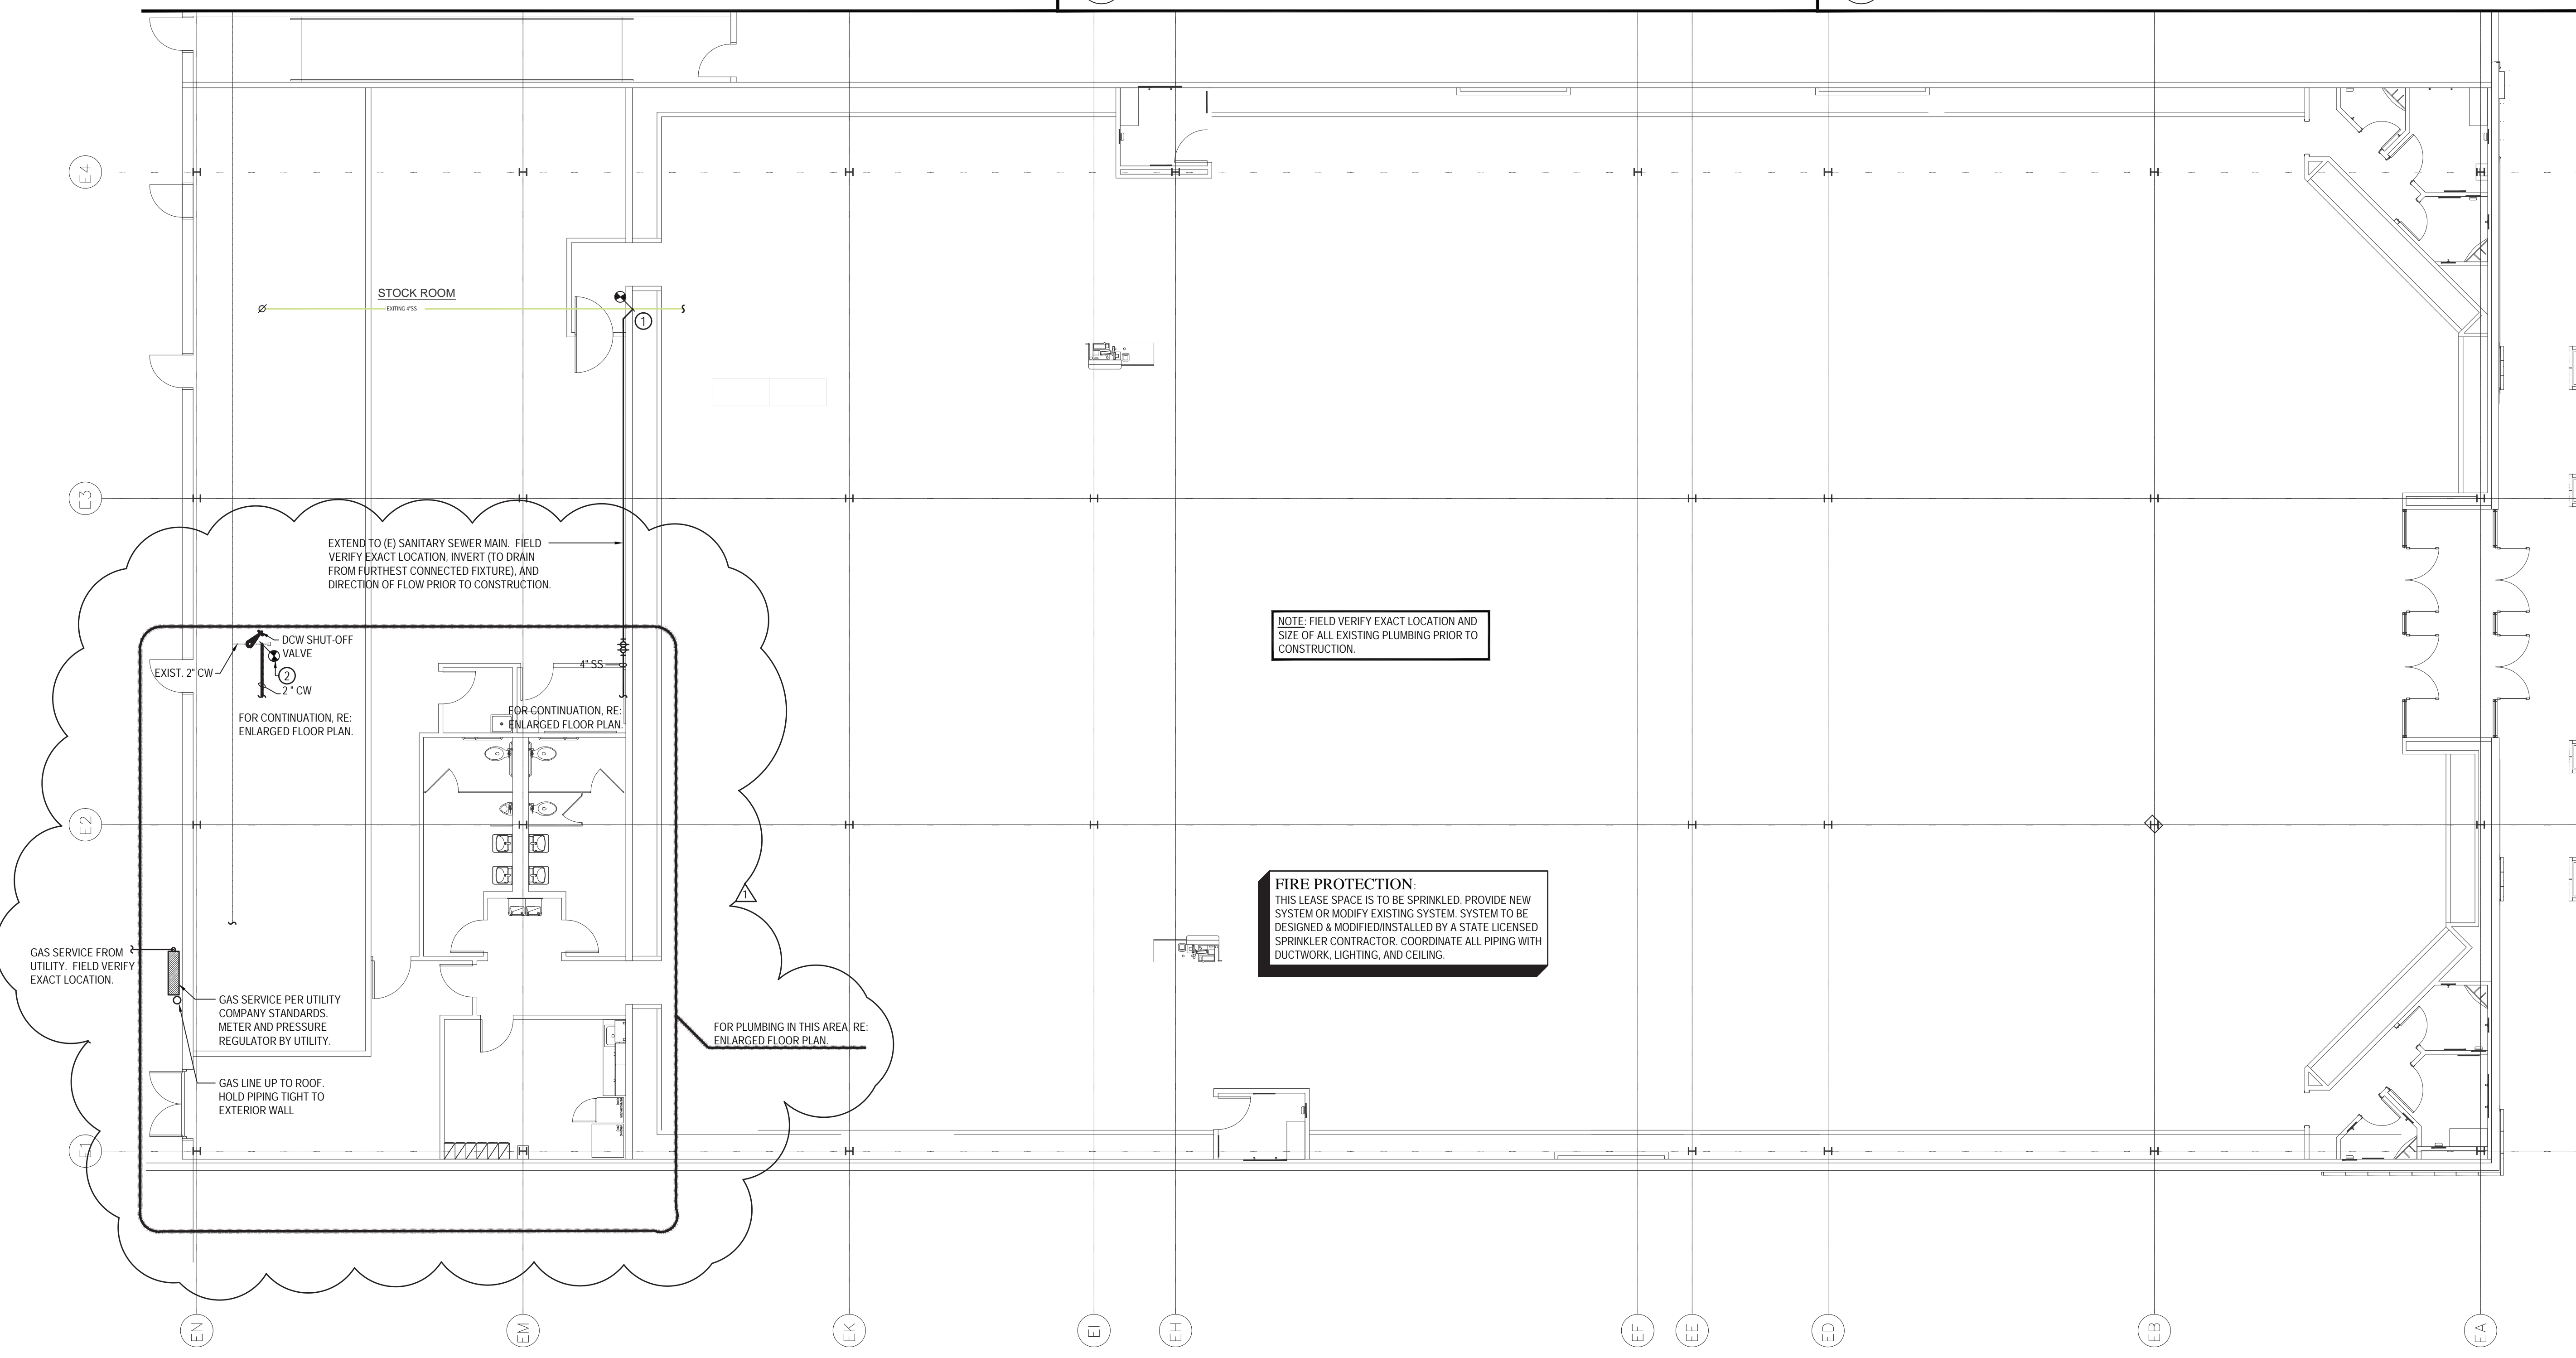

5 PLUMBING SPECIFICATIONS
 NOT TO SCALE

1 PLUMBING FLOOR PLAN
 1/8" = 1'-0"