GENERAL NOTES

1. ALL DUCT SIZES SHOWN ARE INSIDE CLEAR, INCREASE ACCORDINGLY WHERE INTERIOR LINER IS SHOWN OR SPECIFIED.
2. COORDINATE IN THE FIELD THE EXACT LOCATION OF ALL CEILING MOUNTED GRILLES AND DIFFUSERS WITH LIGHT FIXTURES AND (ARCHITECT'S) REFLECTED CEILING PLAN.
3. SENSORS SHALL BE MOUNTED AT +48" AFF (ABOVE FINISHED FLOOR), UNLESS OTHERWISE NOTED.
4. MECHANICAL CONTRACTOR SHALL COORDINATE WITH THE ELECTRICAL CONTRACTOR FOR ALL ELECTRICAL POWER REQUIREMENTS.
5. THESE CONSTRUCTION DRAWINGS ARE DIAGRAMMATIC, AND DO NOT NECESSARILY REFLECT ACTUAL DIMENSIONS. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO FIELD-VERIFY ALL DIMENSIONS AND COORDINATE PLACEMENT OF ALL EQUIPMENT AND ROUTING OF ALL PIPING AND/OR DUCT SYSTEMS.

KEYED NOTES:

1. ROUTE SUPPLY AIR DUCT UP TO ROOFTOP UNIT. TRANSITION DUCT AS REQUIRED TO FIT ROOFTOP UNIT OPENING.
2. ROUTE RETURN AIR DUCT UP TO ROOFTOP UNIT. TRANSITION DUCT AS REQUIRED TO FIT ROOFTOP UNIT OPENING.
3. PROVIDE WIRE MESH OVER THE ENDS OF RETURN AIR DUCT.
4. ROUTE 6"ø EXHAUST DUCT UP TO ROOF. PROVIDE WEATHER PROOF CAP.
5. ROUTE CONDENSATE PIPE ON ROOF.
6. ROUTE CONDENSATE DOWN THROUGH ROOF TO FLOOR DRAIN IN SERVICE ROOM. REFER TO PLUMBING DRAWINGS FOR THE EXACT LOCATION.

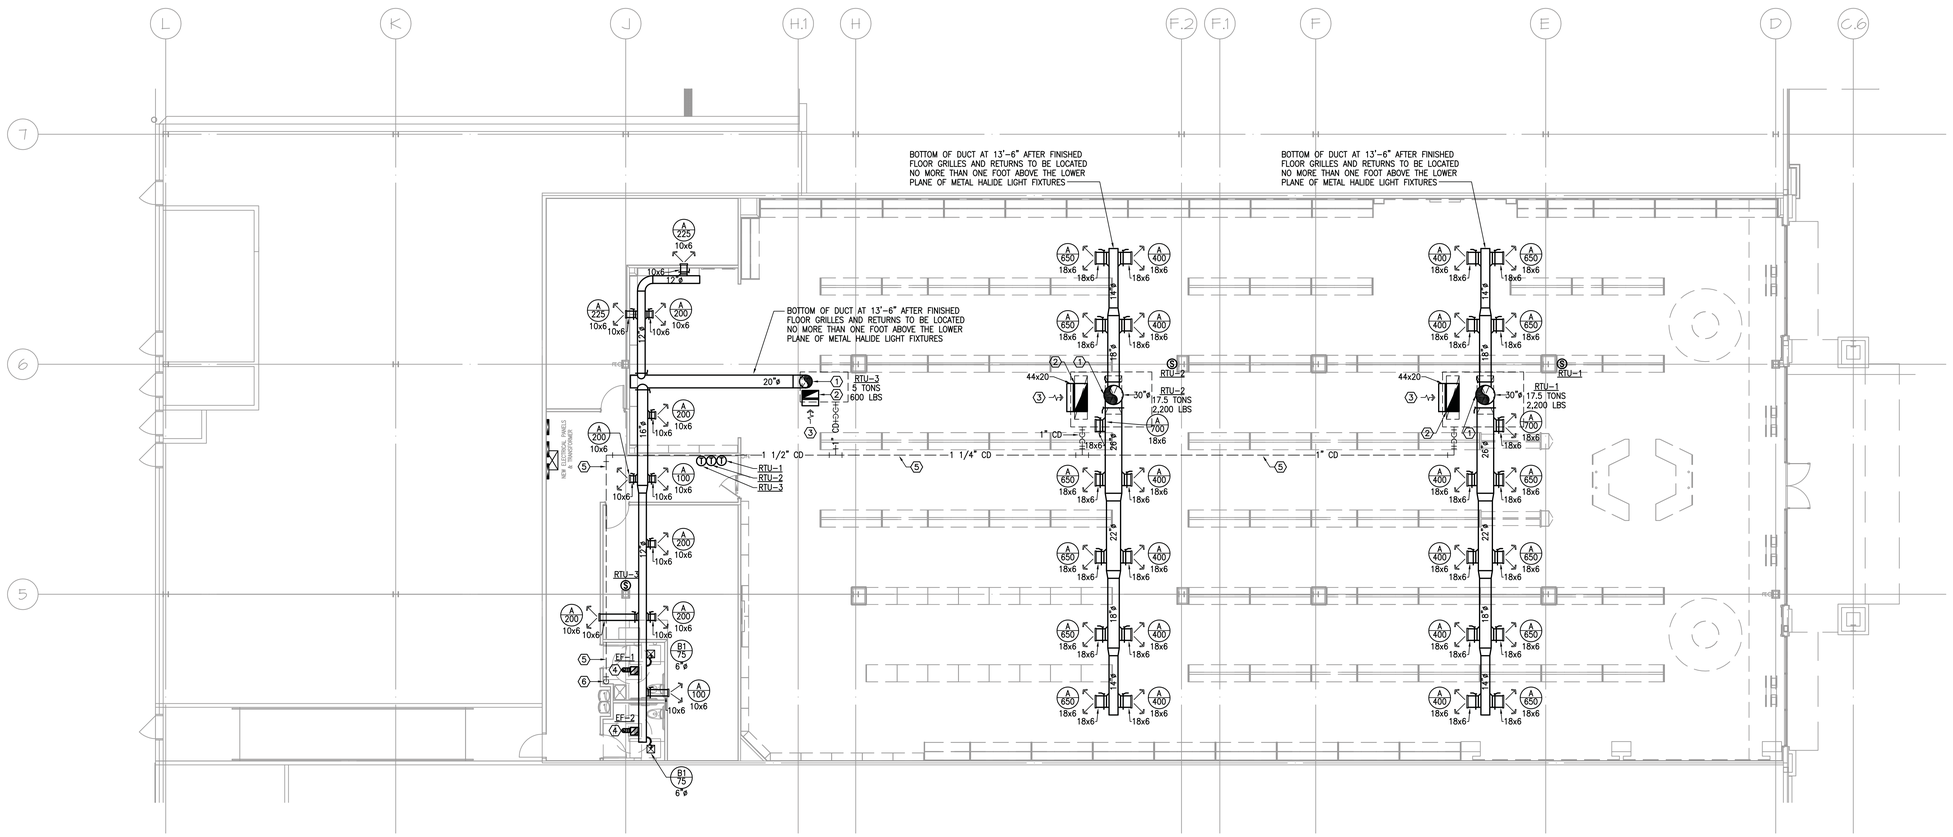

1 **MECHANICAL FLOOR PLAN**
SCALE: 1/8" = 1'-0"

ISSUED FOR CONSTRUCTION
JANUARY 21, 2015

WINDLE + VOLPE
ARCHITECTS
7650 SAN FELIPE, SUITE 200 HOUSTON, TEXAS 77063 PH 713-955-1390

BRADLEY KALMANS
REGISTERED
No. 20219
PROFESSIONAL ENGINEER
01/20/15

SHOE DEPT. ENCORE
CROSSROADS MALL
GREENVILLE, TEXAS

GREENVILLE PROPERTIES LTD.
GREENVILLE, TEXAS

DATE	1/20/2015
PROJECT NO.	08-12-06
DRAWN BY	GH

MECHANICAL FLOOR PLAN

M1.01

KMESALASOBRIEN
expect a difference
Houston | Dallas/Ft. Worth | Baton Rouge
10930 W. Sam Houston Parkway N., Suite 900
Houston, Texas 77064
281.664.1900 | Registration No. F-4111
KMES Project No. 03011009

COPYRIGHT © 2013 WINDLE + VOLPE Architects