

PLUMBING SCOPE & SPECIFICATION

THE WORK OF THIS SECTION SHALL INCLUDE, BUT NOT BE LIMITED TO:

A. A DOMESTIC COLD WATER DISTRIBUTION SYSTEM TO SERVE ALL FIXTURES.
B. A SANITARY SOIL WASTE AND VENT SYSTEM TO SERVE ALL FIXTURES.

DRAWINGS ARE DIAGRAMMATIC, CONFIRM DIMENSIONS AND LOCATIONS IN THE FIELD, ADVISE OF MAJOR DISCREPANCIES.

GUARANTEE LABOR AND MATERIALS FOR ONE YEAR.

ADHERE TO APPLICABLE LOCAL CODES AND REGULATIONS, INCLUDING BUT NOT LIMITED TO THE CITY CODES.

PRODUCE RECORD DRAWINGS.

CONTRACTOR SHALL OBTAIN REQUIRED PERMITS AND PAY ALL FEES.

VALVES

VALVES SHALL BE MANUFACTURED BY NIBCO, HAMMOND, POWELL, STOCKHAM, WATTS OR EQUIVALENT APPROVED BY THE ENGINEER.

BALL VALVES SHALL HAVE CAST BRONZE BODY, BLOWOUT PROOF STEMS, FULL SIZE PORT, 316 STAINLESS STEEL TRIM, TEFLON SEAT AND SEAL AND THRUST WASHERS. VALVES 2" AND SMALLER SHALL BE NIBCO T-585-70-66 OR APPROVED EQUIVALENT.

UNIONS

UNIONS IN COPPER OR BRASS LINES SHALL BE BRASS, THREADED PATTERN UNIONS.

EXCAVATION

EXCAVATE TRENCHES FOR UNDERGROUND PIPING TO THE REQUIRED DEPTH.

CUT THE BOTTOM OF THE TRENCH OR EXCAVATION TO UNIFORM GRADE.

SHOULD ROCK BE ENCOUNTERED, EXCAVATE 6" BELOW GRADE, FILL WITH BEDDING MATERIAL (SAND) AND TAMP WELL.

LAY OUT ALIGNMENT OF PIPE TRENCHES TO AVOID OBSTRUCTIONS, PROVIDE ASSURANCE THAT PROPOSED ROUTE OF PIPE WILL NOT INTERFERE WITH BUILDING FOUNDATION BEFORE ANY CUTTING IS BEGUN, SHOULD INTERFERENCE BE FOUND, CONTACT THE ARCHITECT/ENGINEER BEFORE PROCEEDING.

BACKFILL

BACKFILL SHALL NOT BE PLACED UNTIL THE WORK HAS BEEN INSPECTED, TESTED AND APPROVED. USE SUITABLE FRABLE SOILS AS BACKFILL MATERIAL. DO NOT USE PEAT, SILT, MUCK, DEBRIS OR OTHER ORGANIC MATERIALS. DEPOSIT BACKFILL IN UNIFORM LAYERS.

PLACE BACKFILL MATERIAL IN UNIFORM LAYERS, 8" MAXIMUM LOOSE MEASURE, COMPACT TO NOT LESS THAN 95% OF MAXIMUM SOIL DENSITY AS DETERMINED BY ASTM D698 STANDARD PROCTOR.

PLUMBING PIPING HANGERS

SUPPORT PIPING TO MAINTAIN LINE AND GRADE, WITH PROVISION FOR EXPANSION AND CONTRACTION. USE APPROVED CLEVIS-TYPE OR TRAPEZE-TYPE HANGERS CONNECTED TO STRUCTURAL MEMBERS OF THE BUILDING. SINGLE PIPE RUNS TO BE SUPPORTED BY APPROVED CLEVIS TYPE HANGERS. MULTIPLE PIPE RUNS TO BE SUPPORTED BY APPROVED TRAPEZE TYPE HANGERS. DO NOT SUPPORT PIPING FROM OTHER PIPING OR STRUCTURAL JOIST BRIDGING. REVIEW STRUCTURAL DRAWINGS FOR ADDITIONAL INFORMATION. WHERE INSULATION OCCURS, DESIGN HANGERS TO PROTECT INSULATION FROM DAMAGE. MAXIMUM SPACING SHALL BE 10 FOOT.

THIS CONTRACTOR SHALL FURNISH ALL LABOR, TOOLS, INSTRUCTIONS, AND SUPERVISION REQUIRED IN THE PERFORMANCE OF ALL TESTS, CLEANING AND MAKING NECESSARY ADJUSTMENTS TO OPERATION OF ALL FIXTURES AND EQUIPMENT.

RODDING SEWERS

ALL SANITARY SOIL AND STORM SEWER LINES, BOTH IN THE BUILDING AND OUT SHALL BE RODDED OUT AND FLUSHED OUT AFTER COMPLETION OF CONSTRUCTION AND PRIOR TO FINISH FLOOR BEING INSTALLED. ALL WORK MUST BE COMPLETED PRIOR TO SUBSTANTIAL COMPLETION. ALL FLOOR DRAIN AND CLEANOUT LOCATIONS MUST BE INCLUDED IN THIS WORK

PIPING INSULATION

ALL COLD WATER PIPING, FITTINGS AND VALVES SHALL BE INSULATED WITH NOMINAL 1" WALL THICKNESS IMCOLOCK PIPE INSULATION, OR AN APPROVED EQUAL HAVING FLAME SPREAD RATING OF 25 OR LESS AND A SMOKE DENSITY OF 50 OR LESS WHEN TESTED BY ASTM E-84 METHOD.

ALL HOT WATER AND HOT WATER RETURN PIPING, FITTINGS AND VALVES SHALL BE INSULATED WITH NOMINAL 1" WALL THICKNESS IMCOLOCK PIPE INSULATION, HAVING A CONDUCTIVITY NOT EXCEEDING 0.28 BTU INCH/FT² X 1" X 1".

IMCOLOCK PIPE INSULATION MAY BE SLIPPED ONTO THE PIPE PRIOR TO CONNECTION OR APPLIED AFTER THE PIPE IS INSTALLED, AT THE CONTRACTOR'S OPTION. ALL BUTT JOINTS AND MITER JOINTS SHALL BE CLOSED USING IMCOA'S FUSE SEAL JOINING SYSTEM OR FACTORY APPROVED CONTACT ADHESIVE. IMCOLOCK PIPE INSULATION SHALL BE INSTALLED ACCORDING TO THE PROCEDURES OUTLINED BY THE MANUFACTURER.

FITTING COVER INSULATION SHALL BE FABRICATED AND INSTALLED ACCORDING TO THE MANUFACTURER'S RECOMMENDED PROCEDURES. SWEAT FITTINGS SHALL BE INSULATED WITH MITER CUT PIECES OF IMCOLOCK PIPE INSULATION THE SAME SIZE AS ON ADJACENT PIPING. THREADED FITTINGS SHALL BE INSULATED WITH SLEEVED FITTING COVERS FABRICATED FROM MITER CUT PIECES OF IMCOLOCK PIPE INSULATION ACCORDING TO THE MANUFACTURER'S SLEEVING SIZE RECOMMENDATIONS AND SHALL BE OVERLAPPED 2" AND SEALED TO THE ADJACENT PIPE INSULATION. ALL VALVES SHALL BE INSULATED WITH CUT PIECES OF IMCOLOCK PIPE INSULATION. ALL JOINTS AND MITER CUT PIECES ARE TO BE SEALED USING IMCOA'S FUSE SEAL JOINING SYSTEM OR FACTORY APPROVED CONTACT ADHESIVE.

INSTALL THERMAL INSULATION ON CLEAN, DRY SURFACES AFTER ALL TESTING AND INSPECTION IS COMPLETED. INSTALLATION SHALL BE IN STRICT ACCORDANCE WITH THESE SPECIFICATIONS AND WITH MANUFACTURER'S INSTRUCTIONS.

PIPING SLEEVES

ALL COPPER PIPES PASSING THROUGH CONCRETE OR CINDER WALLS AND FLOORS OR OTHER CORROSIVE MATERIAL SHALL BE PROTECTED AGAINST EXTERNAL CORROSION BY A PROTECTIVE SHEATHING OR WRAPPING OR OTHER MEANS THAT WILL WITHSTAND ANY REACTION FROM THE CORROSIVE MATERIAL. MINIMUM WALL THICKNESS OF MATERIAL SHALL BE 0.025 TO 0.0059 INCH.

PLUMBING FIXTURES

PROVIDE PLUMBING FIXTURES AS SPECIFIED OR PROVIDE FIXTURES EQUAL TO THOSE SPECIFIED.

PLUMBING LEGEND

SYMBOL	DESCRIPTION
— SAN —	SANITARY OR WASTE PIPING ABOVE GRADE (SAN)
— SAN —	SANITARY OR WASTE PIPING BELOW GRADE (SAN)
— V —	VENT PIPING ABOVE OR BELOW GRADE (V)
— CW —	COLD WATER PIPING (CW)
— HW —	HOT WATER PIPING (HW)
— HWR —	HOT WATER RETURN PIPING (HWR)
→	COLD WATER PIPING (CW)
→	HOT WATER RETURN PIPING (HWR)
→	FLOW DIRECTIONAL ARROW
↕	BALL VALVE (BV)
↕	CHECK VALVE
— U —	UNION
— Y —	Y-STRAINER
— RPB —	REDUCED PRESSURE BACKFLOW PREVENTER (RPB/PF)
— P —	PIPING DOWN
— U —	RISE OR DROP PIPING
— U —	PIPING UP —OR— PIPING UP & DOWN
— C —	CAP ON END OF PIPE
— C —	CLEANOUT (WALL OR CEILING) (CO)
— F —	FLOOR CLEANOUT (FCO)
— B —	BRANCH CONNECTION OUT OF TOP
— B —	BRANCH CONNECTION OUT OF BOTTOM
— B —	BRANCH CONNECTION OUT OF SIDE
— W —	WYE & 1/8TH BEND BRANCH CONNECTION
— W —	WYE BRANCH CONNECTION
— H —	WALL HYDRANT
— G —	GAS METER
— K —	REFER TO KEYED NOTE
— F —	FLOOR SINK (FS)
— D —	FLOOR DRAIN (FD)
— D —	FLOOR DRAIN WITH P-TRAP (FD)
— T —	P-TRAP
— E —	INVERT ELEVATION
1/8" DIA 100'	1/8TH OF AN INCH SLOPE

NOTE: NOT ALL SYMBOLS MAY APPLY TO THIS PROJECT.

GENERAL NOTES

- WITHIN THE EXISTING BUILDING, EXISTING HOT AND COLD WATER AND SANITARY WASTE AND VENT SERVICES ARE TO BE MODIFIED AS REQUIRED AND REUSED FOR THE INSTALLATION OF NEW PLUMBING FIXTURES. REFER TO PLUMBING FLOOR PLANS FOR POINTS OF CONNECTION.
- WITHIN THE EXISTING BUILDING, SAWCUT AND REMOVE EXISTING FLOOR SLAB AS REQUIRED TO PROVIDE NEW PLUMBING FIXTURES, CLEANOUTS, AND UNDERSLAB SANITARY WASTE AND VENT PIPING. PATCH AND REFINISH FLOOR TO MATCH EXISTING.
- FIELD VERIFY EXACT LOCATION, SIZE, DEPTH, DIRECTION OF FLOW, CAPACITY, PIPE MATERIAL, AND CONDITION OF EXISTING WATER AND SANITARY WASTE PIPING PRIOR TO BEGINNING CONSTRUCTION. ENSURE THAT PROPER CONNECTIONS TO AND EXTENSION OF SUCH UTILITIES CAN BE MADE.
- SANITARY TO BE CONNECTED TO SHALL BE THOROUGHLY RODDED OUT AND FLUSHED TO ENSURE THEY ARE FREE FROM BLOCKAGES.
- CONTRACTOR SHALL COORDINATE ROUTING OF PIPING BELOW SLAB WITH COLUMN FOOTINGS, GRADE BEAMS, UNDERGROUND PLUMBING AND ELECTRICAL UTILITIES, AND OTHER SUB-SURFACE BUILDING ELEMENTS.
- CONTRACTOR SHALL COORDINATE ROUTING OF PIPING IN CEILING SPACES WITH MECHANICAL AND ELECTRICAL EQUIPMENT, DUCTWORK AND CONDUIT. SHOULD A CONFLICT OCCUR THE CONTRACTOR SHALL NOTIFY THE ARCHITECT/ENGINEER PRIOR TO INSTALLING AN ALTERNATE PIPING PLAN.
- COORDINATE ALL FIXTURE AND EQUIPMENT LOCATIONS AND CONNECTION REQUIREMENTS WITH LATEST ARCHITECTURAL DRAWINGS AND SPECIFICATIONS PRIOR TO ANY ROUGH-INS.
- DO NOT ROUGH-IN FROM THESE DRAWINGS. REFER TO LATEST ARCHITECTURAL DRAWINGS FOR DIMENSIONED LOCATIONS.
- CONTRACTOR TO FIELD VERIFY AS NECESSARY THE EXACT ROUTING AND SIZES OF ALL PIPING.
- ALL WORK, METHODS AND INSTALLATIONS INVOLVED IN THE PLUMBING DESIGN SHALL BE IN ACCORDANCE WITH THE CITY BUILDING CODE AND INSPECTION REGULATIONS AND ALL OTHER OFFICIALS HAVING JURISDICTION.
- PRIOR TO BEGINNING CONSTRUCTION, COORDINATE BUILDING BACKFLOW PREVENTION REQUIREMENTS WITH THE LOCAL AUTHORITY HAVING JURISDICTION AND PROVIDE AS DIRECTED.
- PIPES PASSING THROUGH CONCRETE OR CINDER WALLS AND FLOORS OR OTHER CORROSIVE MATERIAL SHALL BE PROTECTED AGAINST EXTERNAL CORROSION BY A PROTECTIVE SHEATHING OR WRAPPING OR OTHER MEANS THAT WILL WITHSTAND ANY REACTION FROM THE CORROSIVE MATERIAL. MINIMUM WALL THICKNESS OF MATERIAL SHALL BE 0.025 TO 0.0059 INCH.

FIRE SPRINKLER SYSTEM

- DESIGN AND PROVIDE LABOR AND MATERIALS FOR THE COMPLETE MODIFICATION OF AN AUTOMATIC WET PIPE FIRE EXTINGUISHING SPRINKLER SYSTEM WITH THE ATTENDANT ACCESSORIES FOR THE ENTIRE AREA.
- STUDY THE GENERAL, STRUCTURAL, ELECTRICAL AND MECHANICAL DRAWINGS AND SPECIFICATIONS AND FIELD SURVEY THE EXISTING BUILDING IN ORDER TO BECOME FAMILIAR WITH THE BUILDING AND DETAILS AS THEY APPLY TO THE WORK OF THIS SECTION. COOPERATE WITH OTHERS SO THAT THERE WILL BE NO CONFLICT OF SPACE REQUIRED. DUCTWORK AND ELECTRICAL WORK SHALL TAKE PRECEDENCE OVER OTHER WORK, EXCEPT WHERE IT IS ABSOLUTELY NECESSARY TO MAINTAIN COVERAGE PROTECTION.
- THE INSTALLATION OF THE ENTIRE SPRINKLER SYSTEM SHALL COMPLY WITH ALL RULES AND REGULATIONS OF THE NATIONAL BOARD OF FIRE UNDERWRITERS, THE GOVERNING BUILDING CODE, REQUIREMENTS OF NFPA PAMPHLET 13, AND OTHER LOCAL AUTHORITIES EXERCISING JURISDICTION.
- IT SHALL BE THE FIRE PROTECTION CONTRACTOR'S RESPONSIBILITY, PRIOR TO BID, TO VERIFY PRESSURE AT THE PROJECT SITE BY PERFORMING A FLOW TEST. DETERMINE IF THE AVAILABLE STATIC AND RESIDUAL PRESSURE WILL ADEQUATELY PROVIDE THE FIRE EXTINGUISHING SYSTEM WITH THE NECESSARY PRESSURE OR IF A FIRE PUMP, BREAK TANK AND NECESSARY APPURTENANCES ARE REQUIRED.
- PROVIDE SCHEDULE 40 BLACK STEEL PIPE AND FITTINGS IN ACCORDANCE WITH THE REQUIREMENTS OF NFPA FOR APPLICABLE FIRE PROTECTION SYSTEMS. CONFORM TO ASTM A53 AND A132. PROVIDE PIPING WITH MALLEABLE IRON, CAST IRON, STEEL WELDED OR SCREWED FITTINGS. VICTALIC GROOVED FITTINGS MAY BE USED ABOVE GRADE IN ACCESSIBLE LOCATIONS ONLY.

PLUMBING FIXTURE SCHEDULE

FIXTURE	QTY.	MFG.	CATALOG NO.	COLOR	CONNECTION DATA					REMARKS
					SOIL SIZE	VENT SIZE	TRAP	WATER		
								COLD	HOT	
WATER CLOSET (WC-1)	2	*CRANE	31054	WHITE	4"	2"	3"	1/2"	---	WHITE OPEN HINGED SEAT, LEFT HAND TRIP LEVER, ADA, MODEL #3544
LAVATORY (LAV)	2	*CRANE	1H-364-V	WHITE	1 1/2"	1 1/2"	1 1/2"	1/2"	1/2"	FAUCET 4" CTRS. POP-UP 18"x21" VITREOUS CHINA
FLOOR DRAIN	3	*JOSAM	30000-S-Z	----	3"	2"	3"	----	----	w/6" STRAINER
TRAP PRIMER	2	*WATTS	A200S/LF	----	----	----	----	1/2"	----	"LOW FLOW" MODEL
ELECTRICAL DRINKING FOUNTAIN (HCDF)	1	*ELKAY	EZSTL8C	----	1 1/2"	1 1/2"	1 1/2"	3/8"	----	FRONT & SIDE PUSHBARS BARRIER-FREE ACCESS
MOP SINK (MSK)	1	*JONESPEC	MB-2600-24	WHITE	2"	2"	1 1/2"	1/2"	1/2"	#SF FAUCET, #SD DRAIN, #HH-30" HOSE & BRACKET

* OR APPROVED EQUAL

NEW PLUMBING FIXTURE CALCULATIONS

PLUMBING FIXTURE	SANITARY FIXTURE QUANTITY	SANITARY FIXTURE UNIT EA.	SANITARY FIXT. UNIT TOTAL	VENT SIZE EACH	C.W. F.U. EACH	C.W. F.U. TOTAL
WATER CLOSET	2	6	12	3"	5	10
LAVATORY	2	1	2	1 1/2"	2	4
FLOOR DRAIN	3	2	6	2"	—	—
TRAP PRIMER	3	—	—	2"	1/2	1
DRINKING FOUNTAIN	1	1/2	1/2	1 1/2"	1/2	1/2
MOP SINK	1	2	2	2"	1/2	1/2
TOTALS			22 1/2	—		16
SERVICE CONNECTION SIZE				SAN.	VENT	C.W.
				4"	4"	3/4"

ELECTRIC WATER HEATER

ITEM NO.	TOTAL KW INPUT	GALS. PER HR. RECOVERY RATE 100°F RISE	STORAGE CAPACITY (GALLONS)	ELECTRICAL REQUIRED	STORED WATER TEMP	MANUFACTURER COMMENT
EWH-1	1.5	6	6	120V, 1φ	140°	RHEEM-RUUD MODEL EGP6

NOTES:
PROVIDE HOT WATER EXPANSION TANK DOWNSTREAM OF CHECK VALVE ON COLD WATER SUPPLY. THERM-X-TROL ST-5.

PLUMBING CONTRACTOR'S NOTES

ALL OF THE PLUMBING/PIPING WORK IS NOT NECESSARILY SHOWN OR NOTED ON THESE DRAWINGS. THE CONTRACTORS SHALL VISIT THE JOB SITE AND FIELD VERIFY ALL EXISTING CONDITIONS RELATED TO THE WORK PRIOR TO BIDDING. THOSE ITEMS NOT SHOWN OR NOTED BUT WHICH ARE DEEMED NECESSARY FOR REMOVAL OR RELOCATION BY OWNER OR HIS REPRESENTATIVE SHALL BE PART OF THIS CONTRACT. THE SUBMISSION OF THE PROPOSALS SHALL BE CONSIDERED EVIDENCE THAT THE CONTRACTORS HAVE VISITED THE SITE. NO EXTRA PAYMENTS WILL BE ALLOWED THESE CONTRACTORS DUE TO EXTRA WORK MADE NECESSARY BY HIS FAILURE TO VISIT THE JOB SITE.

DO NOT ATTACH ANYTHING DIRECTLY TO THE DECK OR DUCTWORK ABOVE. ALL EQUIPMENT SHALL BE FASTENED TO THE TOP CHORD OF JOISTS OR TOP OF BEAMS.

CONTRACTOR'S NOTE:

WRITTEN DIMENSIONS HOLD PREFERENCE OVER SCALED DIMENSIONS.

DO NOT SCALE DRAWINGS.

CONTRACTOR'S MUST VISIT JOB SITE TO VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS. ANY DISCREPANCIES IN EXISTING CONDITIONS AS SHOWN SHOULD BE BROUGHT TO THE ATTENTION OF HIBBETT'S CONSTRUCTION DEPARTMENT AND CLARIFIED BEFORE SUBMITTING BIDS. CHANGE ORDERS WILL NOT BE ALLOWED FOR ANY WORK REQUIRED DUE TO EXISTING CONDITIONS NOT BEING FIELD VERIFIED BY CONTRACTOR PRIOR TO SUBMITTING BID.

REPORT DISCREPANCIES DURING BIDDING PROCESS AND BEFORE START OF CONSTRUCTION WHICH MAY INTERFERE WITH THE PROPER EXECUTION OF WORK TO HIBBETT'S CONSTRUCTION DEPARTMENT PRIOR TO COMMENCEMENT OF ANY WORK.

THERMOSTATIC MIXING VALVES

ITEM NO.	INLET HOT WATER TEMP (°F)	OUTLET MIXED WATER TEMP (°F)	MINIMUM FLOW (GPM)	DESIGN FLOW (GPM)	PRESSURE DROP (PSI)	VALVE FINISH	MANUFACTURER / MODEL NO.
TWV-1	140°	110°	0.5	5	5.0	ROUGH BRONZE	SYMMONS 5-210-CK-W

- NOTES:
- MAKE WATER CONNECTIONS TO THERMOSTATIC MIXING VALVE(S) IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS.
 - PROVIDE PIPE INCREASERS AND/OR VALVES AS REQUIRED.
 - PROVIDE UNION CONNECTIONS AND OUTLET THERMOMETER UNLESS INDICATED OTHERWISE.

PIPE MATERIAL LIST

WATER PIPING

ABOVE SLAB INSIDE THE BUILDING SHALL BE SEAMLESS ASTM B 88 TYPE L COPPER WATER TUBE WITH WROUGHT COPPER FITTINGS, ANSI B16.22. SOLDER MATERIAL SHALL BE 95.5 PERCENT LEAD FREE, ASTM B 32. THE USE OF DRILLED-T CONNECTIONS IS NOT PERMITTED.

BELOW SLAB SHALL BE ASTM B 88 TYPE K COPPER WATER TUBE WITH WROUGHT COPPER FITTINGS, ANSI B16.22. ALL JOINTS SHALL BE BRAZED.


SANITARY SOIL WASTE AND VENT PIPING

ABOVE SLAB INSIDE BUILDING SHALL BE SERVICE WEIGHT CAST IRON BELL AND SPIGOT SOIL PIPE AND FITTING SYSTEM CONFORMING TO ASTM STANDARD A 74. COMPRESSION GASKETS SHALL CONFORM TO ASTM STANDARD C 564.

BELOW SLAB SHALL BE SCHEDULE 40 DWV POLYVINYL CHLORIDE PIPE AND FITTINGS CONFORMING TO ASTM D-1784-82 WITH SOLVENT WELDED JOINTS.

NOTE:
PVC PROHIBITED WITHIN PLENUMS.

WINDLE + VOLPE
ARCHITECTS
 7650 AMH TRF. SUITE 200
 HOUSTON, TEXAS 77065
 PH 713-951-1990

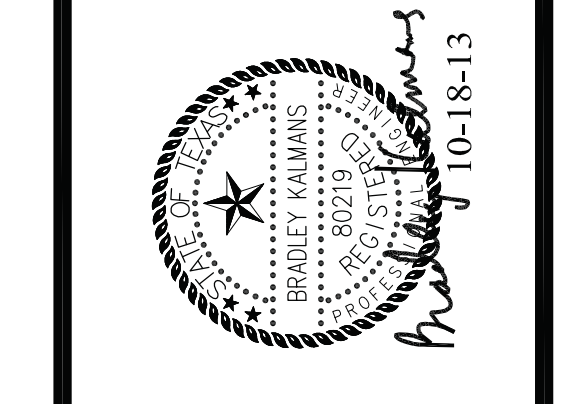

HIBBETT SPORTS
CROSSROADS MALL
 GREENVILLE, TEXAS
GREENVILLE PROPERTIES LTD.
 GREENVILLE, TEXAS

DATE	10/14/2013
PROJECT NO.	08-12-07
DRAWN BY	

PLUMBING SCHEDULES

P2-1

