


- NOTES:
1. THE ALARM LOCK DELAY EGRESS DEVICE IS THE HIGHEST QUALITY, MOST DURABLE AND MOST RELIABLE DELAYED EGRESS DEVICE AVAILABLE TO THE COMMERCIAL MARKET TODAY. IT IS HOWEVER A DEVICE THAT MUST BE KNOWLEDGEABLY INTEGRATED BY THE ARCHITECT AND ENGINEER-OF-RECORD WITHIN THE DESIGN OF THE BUILDING FIRE ALARM AND ELECTRICAL SYSTEMS AS WELL AS THE DOOR AND HARDWARE SYSTEMS. ADDITIONAL INFORMATION ABOUT THE DEVICE AND ITS INSTALLATION MAY BE OBTAINED FROM THE CONTACT LISTED ON PROTOTYPE SHEET A0.0.
 2. THE DELAYED EGRESS SYSTEM AND ASSEMBLIES ARE TO BE THOROUGHLY AND CORRECTLY PRESENTED IN THE PROJECT CONSTRUCTION DOCUMENTS BY THE ARCHITECT AND ENGINEER-OF-RECORD.
 3. THE DELAYED EGRESS FUNCTION OF THE DEVICE WILL NOT FUNCTION PROPERLY UNLESS THE DEVICE IS CORRECTLY CONNECTED TO A FIRE ALARM / SMOKE DETECTION SYSTEM. BOTH THE FIRE ALARM AND SMOKE DETECTION ARE REQUIRED BY THIS PROTOTYPE.
 4. WHETHER OR NOT THE FIRE ALARM SYSTEM DESIGN IS UNDER THE SUPERVISION OF THE LANDLORD'S ARCHITECT-OF-RECORD, THAT ARCHITECT OR IN THE ABSENCE OF THE ARCHITECT, THE LANDLORD IS RESPONSIBLE TO ENSURE THAT THE DELAYED EGRESS DEVICE AND SYSTEM ARE COORDINATED WITH AND CORRECTLY SHOWN AND IDENTIFIED IN THE FIRE ALARM CONSTRUCTION DOCUMENTS.
 5. DETAIL 1 PROVIDES A TYPICAL INSTALLATION DIAGRAM OF THE DEVICE AT A TYPICAL EGRESS DOOR.
 6. DETAIL 2 SHOWS A TYPICAL WIRING SCHEMATIC FOR THE DEVICE.
 7. THESE DETAILS AND THIS SHEET ARE PROVIDED AS A CONVENIENCE TO THE LANDLORD AND ARCHITECT-OF-RECORD. IT IS NOT TO BE ASSUMED THAT THESE DETAILS AND THE TYPICAL ASSEMBLY ILLUSTRATED GIVE A COMPLETE AND ACCURATE REPRESENTATION OF THE INSTALLATION APPROPRIATE FOR THE ACTUAL CONDITIONS OF THE SITE-SPECIFIC PROJECT.
 8. CAUTION: THE DEVICE, IN PARTICULAR THE SIGNAL PROCESSOR, CAN BE DAMAGED OR DESTROYED IF INSTALLATION IS ATTEMPTED BY A NOVICE. INSTALLATION, IN PARTICULAR ALL ELECTRICAL CONNECTIONS, MUST ONLY BE PERFORMED BY AN EXPERIENCED, QUALIFIED AND TRAINED TECHNICIAN.
 9. ALL DELAYED EGRESS DEVICES, 10-15 SECOND DELAY, REQUIRED FOR THE PROJECT TOGETHER WITH ALL RELATED SYSTEMS, REGARDLESS OF THE DESIGN AND INSTALLATION RESPONSIBILITIES, MUST BE COMPLETE, FULLY OPERATIONAL AND FUNCTIONING AT THE TIME OF PROJECT DELIVERY AND REMOVAL. NO EXCEPTIONS.

1 TYPICAL DEVICE INSTALLATION ISOMETRIC
SCALE: 1 1/2" 1'-0"

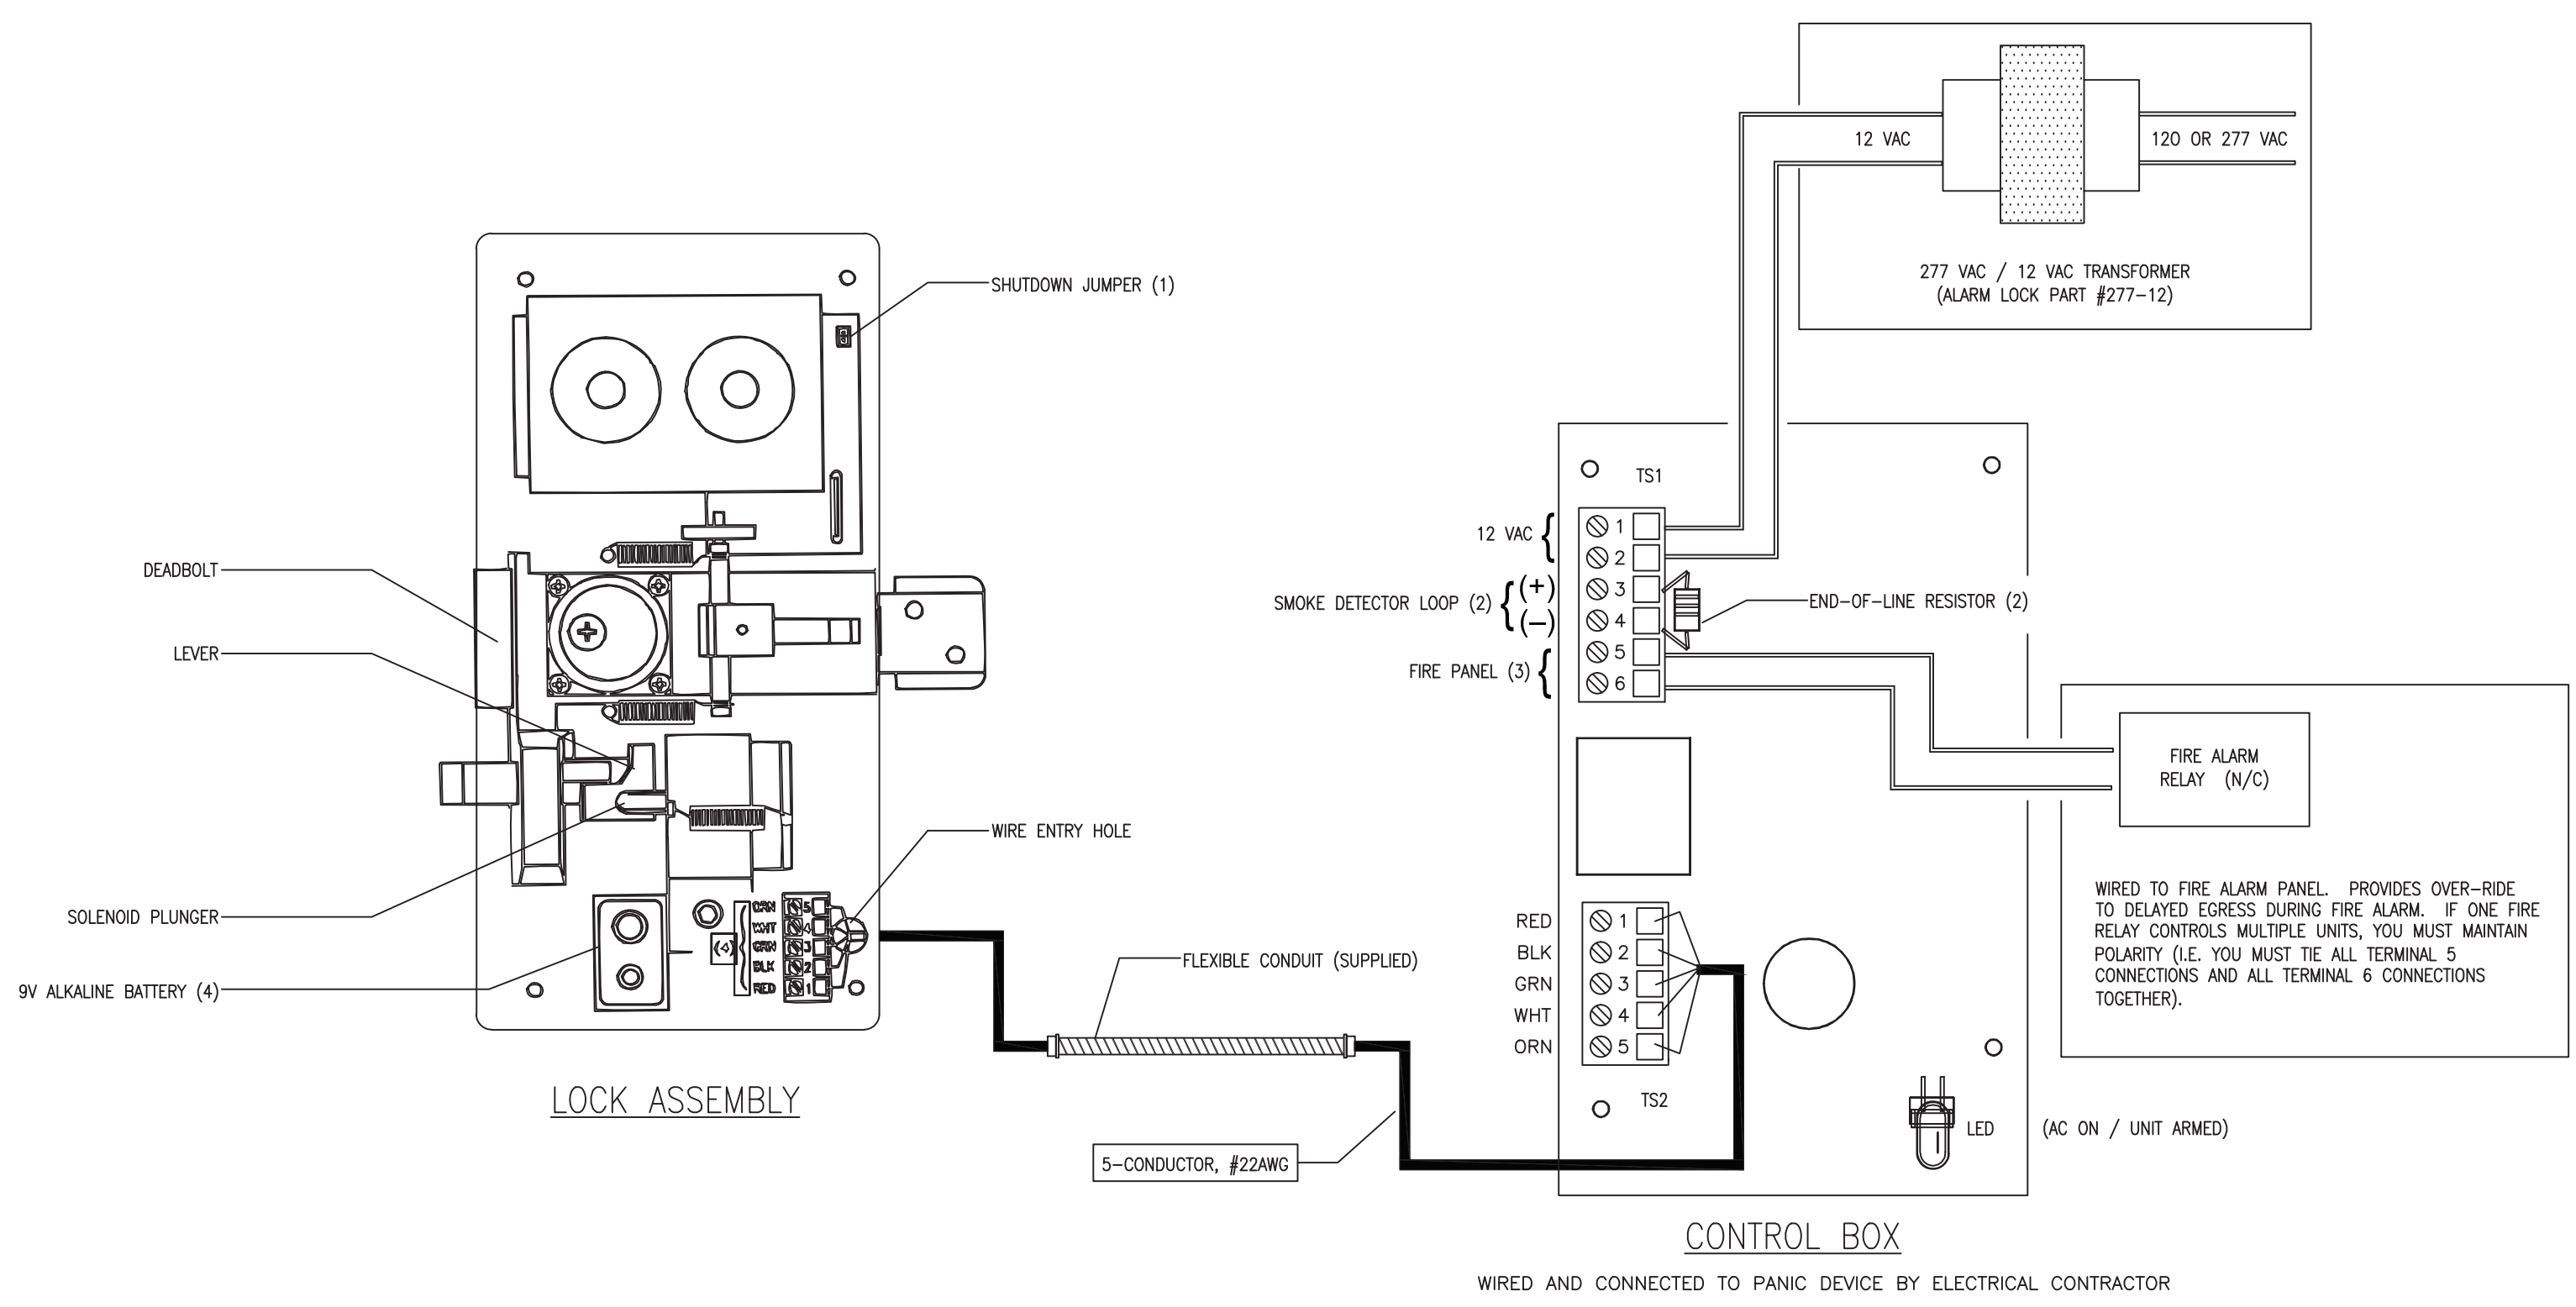

- KEY NOTES:
- (1) REMOVE JUMPER FOR TWO-MINUTE ALARM SHUTDOWN
 - (2) IF SMOKE DETECTOR IS USED, REMOVE END-OF-LINE RESISTOR AND INSTALL AC ROSS SMOKE-DETECTOR TERMINALS
 - (3) REMOVE JUMPER IF CONNECTING TO FIRE PANEL OR REMOTE NORMALLY-CLOSED KEYSWITCH.
 - (4) BATTERY MUST BE INSTALLED, HOWEVER DO NOT CONNECT BATTERY UNTIL AC POWER IS APPLIED.

2 TYPICAL DEVICE WIRING DIAGRAM
SCALE: N.T.S.

