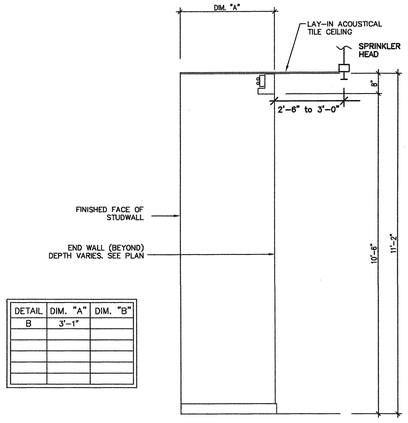

DETAIL	DIM. "A"	DIM. "B"
B	3'-1"	

B LIGHTING SECTION

SCALE : 1/2" = 1'-0"

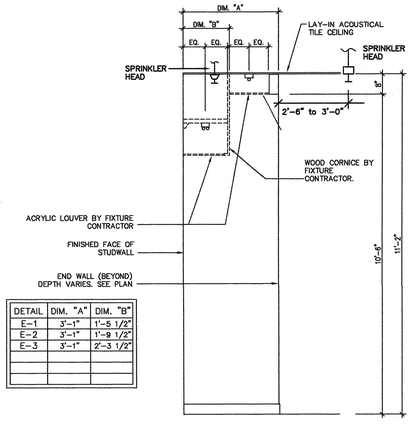

DETAIL	DIM. "A"	DIM. "B"
E-1	3'-1"	1'-5 1/2"
E-2	3'-1"	1'-9 1/2"
E-3	3'-1"	2'-3 1/2"

E LIGHTING SECTION

SCALE : 1/2" = 1'-0"

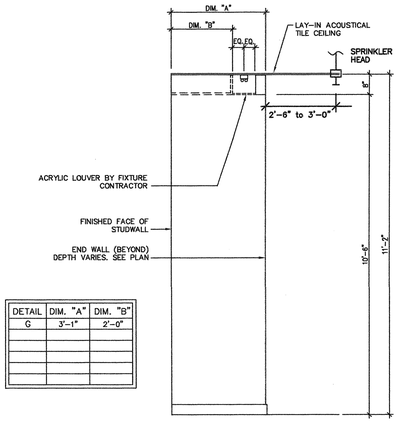

DETAIL	DIM. "A"	DIM. "B"
G	3'-1"	2'-0"

G LIGHTING SECTION

SCALE : 1/2" = 1'-0"

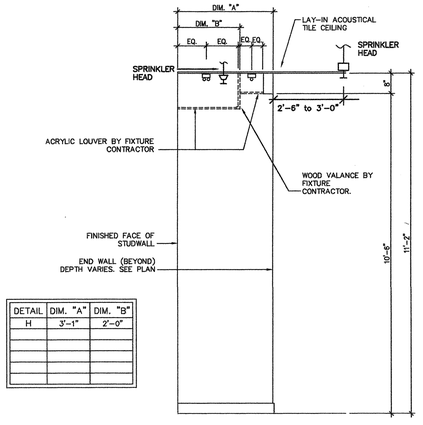

DETAIL	DIM. "A"	DIM. "B"
H	3'-1"	2'-0"

H

SCALE : 1/2" = 1'-0"

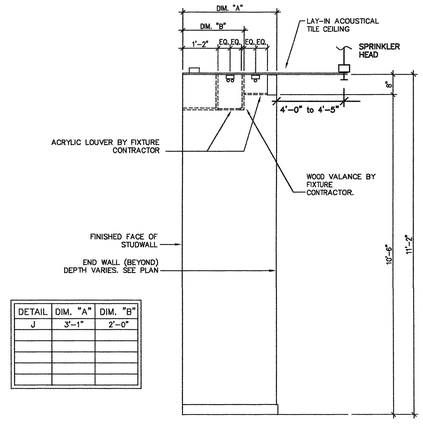

DETAIL	DIM. "A"	DIM. "B"
J	3'-1"	2'-0"

J LIGHTING SECTION

SCALE : 1/2" = 1'-0"

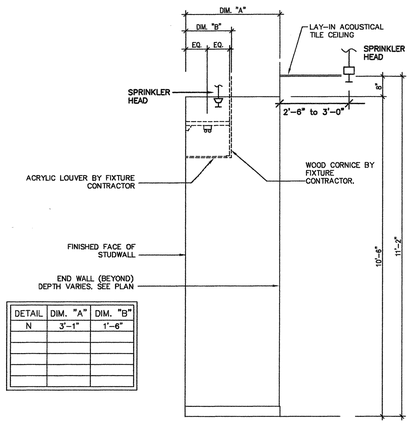

DETAIL	DIM. "A"	DIM. "B"
N	3'-1"	1'-6"

N LIGHTING SECTION

SCALE : 1/2" = 1'-0"

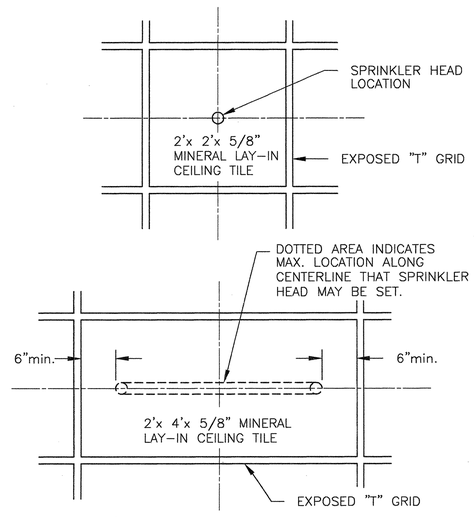

1 / FP-3 CEILING GRID SYSTEM

SCALE: 1"= 1'-0"

GENERAL FIRE PROTECTION

1. DO NOT SCALE DRAWINGS. SEE ARCHITECTURAL DRAWINGS AND REFLECTED CEILING PLANS FOR EXACT LOCATION OF PARTITIONS, CEILING CONFIGURATIONS, LIGHTS, VALANCES, etc. RELOCATE ALL EXISTING HEADS AND REPLACE ALL HEADS WITH NEW HEADS.
2. FURNISH ALL LABOR, MATERIAL, AND EQUIPMENT REQUIRED FOR THE COMPLETION AND OPERATION OF ALL SYSTEMS IN THIS SECTION OF WORK IN ACCORDANCE WITH ALL APPLICABLE CODES.
3. SPRINKLER CONTRACTOR SHALL COORDINATE CLOSELY WITH MECHANICAL AND ELECTRICAL CONTRACTORS TO AVOID INTERFERENCE WITH OTHER TRADES.
4. ANY EXISTING SPRINKLER SHUT-OFF VALVES OR DRAIN VALVES THAT ARE TO BE ENCLOSED BEHIND WALL, AN ACCESS PANEL SHALL BE PROVIDED.
5. VERIFY EXACT LOCATION OF ALL CROSS MAIN PIPING, BOTH VERTICAL AND HORIZONTAL, SO AS NOT TO CONFLICT WITH NEW ARCHITECTURAL DESIGN.
6. ALL EXISTING SPRINKLER HEADS SHALL BE REMOVED BEFORE NEW CEILING GRID IS INSTALLED. AFTER INSTALLATION, NEW SPRINKLER HEADS CAN BE INSTALLED.
7. SPRINKLER SYSTEM SHALL MEET UNDERWRITERS AND BELK REQUIREMENTS, AS WELL AS NFPA 13 CODE.
8. SPRINKLER CONTRACTOR SHALL REVIEW BELK EXISTING SPRINKLER HEAD LOCATION DRAWINGS. NO CHANGE IN CONTRACT PRICE WILL BE ALLOWED FOR SPRINKLER CONTRACTOR ADDING SPRINKLER HEADS TO MEET NFPA 13. IF CONTRACTOR INTERPRETS NFPA 13 TO REQUIRE ADDING HEADS OVER EXISTING QUANTITY SHOWN, IT WILL BE HIS RESPONSIBILITY TO PROVIDE THIS COVERAGE AT NO ADDITIONAL COST. CONTRACTOR SHALL PREPARE SHOP DRAWINGS SHOWING PIPE CHANGES AND ALL NEW & EXISTING HEAD LOCATIONS AND RECEIVE APPROVAL PRIOR TO CONSTRUCTION. NO ADDITIONAL COST FOR RELOCATION OF EXISTING PIPING WILL BE CONSIDERED.
9. SPRINKLER SYSTEM SHALL BE RETURNED TO WORKING CONDITION AT THE END OF EACH WORKING DAY.
10. ALL NEW SPRINKLER HEADS AND PLATES SHALL BE AS SPECIFIED.
11. SPRINKLER HEADS CONFLICTING WITH RECESSED INCADESCENT LIGHTS OR TRACK LIGHTS SHALL BE COORDINATED WITH ELECTRICAL CONTRACTOR. WHERE HEAD CANNOT BE RELOCATED WITHOUT ADDING A HEAD, LIGHT SHALL BE RELOCATED.

Expiration: 7/31/99
Affixed: 2/17/99

2-5-99

RPDG
RETAIL PLANNING DESIGN GROUP
ARCHITECTURE • INTERIOR PLANNING & DESIGN • CONSTRUCTION ADMINISTRATION FOR RETAIL STORES
2801 WEST TYVOLA ROAD • CHARLOTTE, NC • 28217-4500 • (704) 357-7664 • FAX (704) 357-4831

CONSULTANTS
DAVID N. SHULTZ, P.E.
CONSULTING ENGINEER
GRAHAM, N.C.
(336)-438-9811
(704) 334-1283
(336) 226-7947

PROJECT
BELK CROSSROADS MALL
GREENVILLE, TX
WALMART CONVERSION

SHEET TITLE
FIRE PROTECTION PLAN
VALANCE DETAILS

GROUP	STORE NUMBER
AR CAPUANA	1 1 2 4

REVISED	REVISED	REVISED	REVISED
1-4-99	AS PER PLAN CHECK COMMENTS	2-5-99	ARCHITECTURAL

INTERIOR PLANNING SHEET NUMBER
–
OF SHEETS

ARCHITECTURAL SHEET NUMBER
FP-3
OF 3 SHEETS